


XFMR housing to BUILDING GROUND connection made between 2 washers shown on Hardware Stack (HS) drawing.

HS1: Hardware Stack 1

PRI ESS ISOLATED GROUND





Primary shield tab.

HS2

Shown in hardware stack as a green lead.

#2 AWG cable

Saturable Inductor is located outside of transformer enclosure.

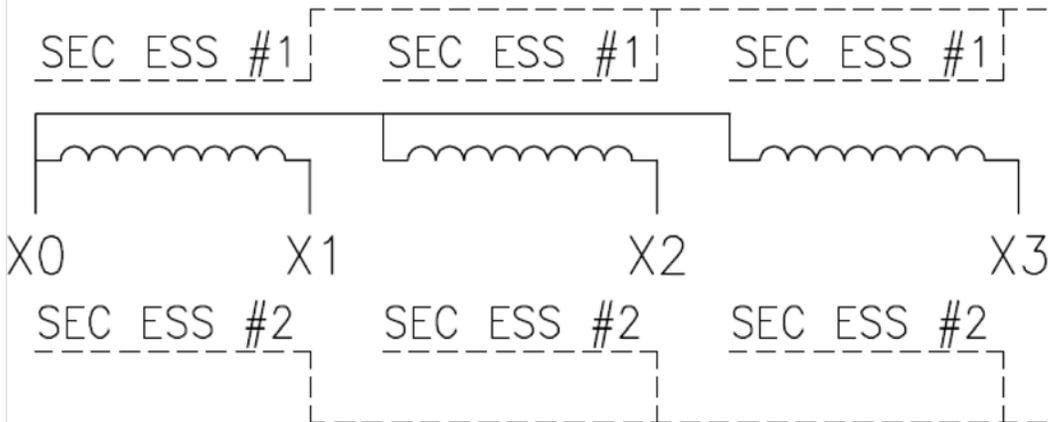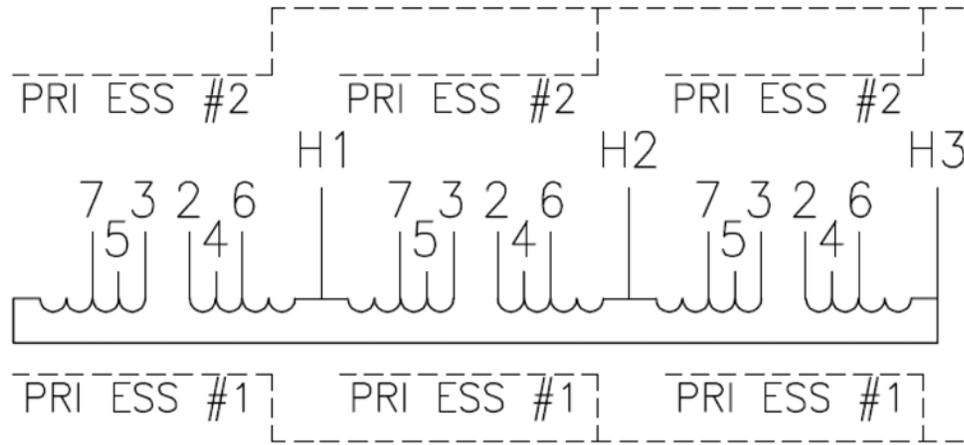

Secondary Shield tab- Connections made using same type of hardware stack.

SEC ESS ISOLATED GROUND

HS3

