
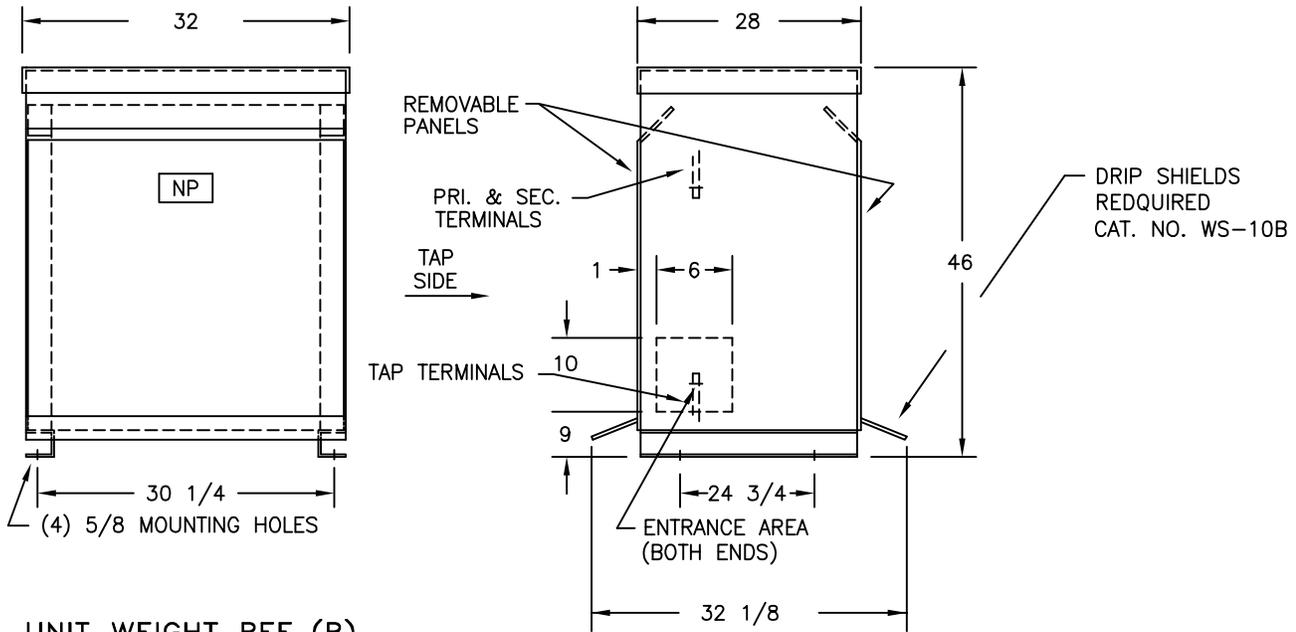


**NOTES:**

1. ALL UNITS ARE UL LISTED AND ARE DESIGNED IN ACCORDANCE WITH APPLICABLE NEMA, ANSI, AND IEEE STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED NEMA 2 ENCLOSURE FOR INDOOR WITH SUPPLIED DRIP SHIELDS.
3. TRANSFORMERS ARE FLOOR MOUNTED.
4. TRANSFORMERS HAVE 220°C CLASS INSULATION SYSTEM WITH THE AVERAGE WINDING TEMPERATURE RISE BASED ON 40°C MAXIMUM AMBIENT.
5. PAINT COLOR IS ANSI #61.

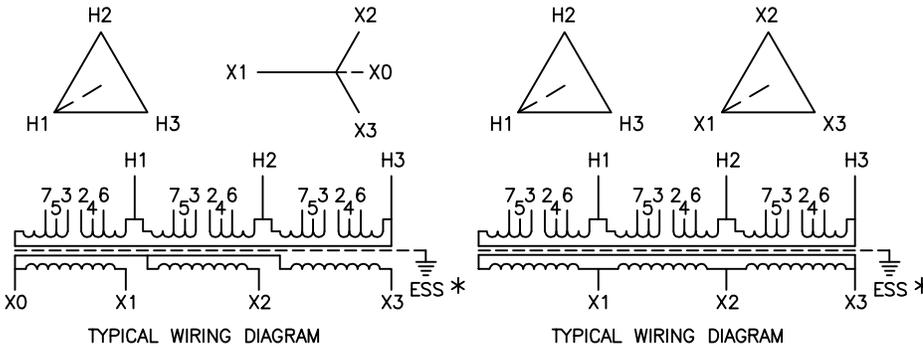

**UNIT WEIGHT REF. (B)**

NET WT. IN LBS.	A	B
ALUMINUM	1180	915
COPPER	1330	1080

**ADDITIONAL FEATURES:**

- \*  DOUBLE ELECTROSTATIC SHIELD ISOLATED AT FACTORY
- SUITABLE FOR NONSINUSOIDAL CURRENT LOAD WITH K-FACTOR NOT TO EXCEED K-13
- SEPARATE GROUNDING PROVISIONS FOR PRIMARY SHIELD, SECONDARY SHIELD, AND ENCLOSURE GROUND

% IMPEDANCE 1.8-4.5%

DRAWINGS	
<input checked="" type="checkbox"/>	APPROVAL
<input type="checkbox"/>	RECORD
<input type="checkbox"/>	OTHER

QUANTITY	3	CUST.	FERMILAB		
KVA	75	JOB			
PRIMARY VOLTAGE	480	P.O.	607086		
SECONDARY VOLTAGE	208Y/120	S.O.	220663		
TEMPERATURE RISE IN °C	115	CATALOG NO.			
WINDINGS & TERMINALS	<input type="checkbox"/> ALUMINUM <input checked="" type="checkbox"/> COPPER	SOUND LEVEL	47 dB		
FREQUENCY	60	BY	T.D.	ENG. LOG.	TITLE TP1 ENERGY EFFICIENT COMPLIANT DRY TYPE TRANSFORMER K-FACTOR RATED THREE PHASE, 600 VOLT CLASS
TAPS	+2, -2 X 2 1/2%	DATE	6-18-08		
<b>FEDERAL PACIFIC</b>		REV	3	MFG. LOG.	DWG. NO.
		DATE:	8-23-12	DWG. FILE	D4808A6251-220663

HOLD FOR APPROVAL AND/OR RELEASE ORDERS ARE VALID FOR 60 DAYS. PRICE IS SUBJECT TO CHANGE AFTER 60 DAYS.